

Application Note

Interconnection Guidelines for Yaskawa Solectria Solar XGI 1500

XGI 1500:

XGI 1500-125/125-UL, XGI 1500-125/150-UL,
XGI 1500-150/166-UL, XGI 1500-166/166-UL,
XGI 1500-175-480, XGI 1500-200/200-480,
XGI-225-600, XGI 1500 250/250-600

October 23, 2025
Version E

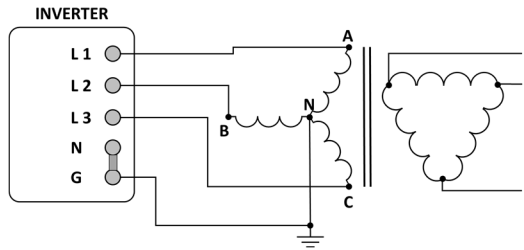
1. Document Modification History

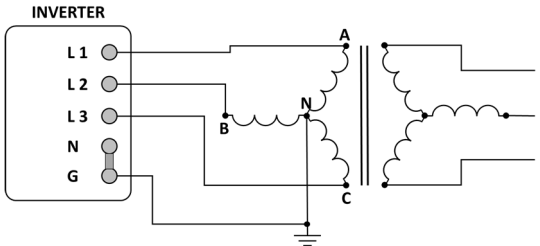
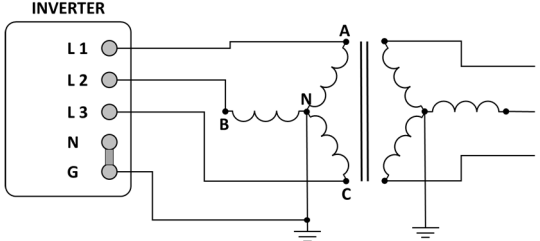
DATE	VERSION	SECTION	MODIFICATION	BY
1/27/25	D	All	Removal of XGI 1000 inverter line	HA
10/23/25	E	2	N point shall be isolated if N conductor pulled	EH

2. Interconnection Service Requirements

Yaskawa Solectria Solar’s XGI 1500 three-phase transformerless inverters require AC output connection to a WYE configured service with a solidly grounded neutral. The XGI inverter leaves the factory with neutral bonded to Equipment Ground; the XGI inverter uses the neutral for AC voltage sensing. It is not necessary to run a neutral conductor. However, if a neutral conductor is installed in the field between the service and the XGI inverter, it will not carry current. Therefore, if the installer chooses to run a neutral conductor between the transformer and the inverter, the size of the neutral conductor may be reduced to the same size as the EGC, but not smaller than the EGC. As well, the neutral terminal must be isolated from the ground in the inverter with the included insulating standoff. Acceptable service configurations are depicted in the table below.

Acceptable Service Configurations

XGI 1500 Inverter-Facing Transformer Winding	System Configuration	XGI 1500 Utility-Facing Transformer Winding	XGI 1500 Inverter Compatibility
Grounded-WYE	<p>Neutral Bonded to Ground</p> 	Delta	Compatible

<p>Grounded-WYE</p>	<p style="text-align: center;">Neutral Bonded to Ground</p> 	<p>WYE</p>	<p>Compatible</p>
<p>Grounded-WYE</p>	<p style="text-align: center;">Neutral Bonded to Ground</p> 	<p>Grounded-WYE</p>	<p>Compatible</p>

Note: Any system configurations not shown in the tables above are NOT compatible with the XGI 1500 inverters, and an intermediary transformer shall be used.

3. Paralleling Multiple Inverters

3.1 Maximum Numbers of Inverters in Parallel

The maximum number of Yaskawa Solectria Solar's XGI 1500 three-phase, transformerless inverters that may be connected in parallel to one common point of connection, is shown in the table below:

Inverter Model	Maximum Number of XGI Inverters Allowed in Parallel
XGI 1500-125/125-UL, XGI 1500-125/150-UL XGI 1500-150/166-UL, XGI 1500-166/166-UL	30 inverters per transformer
XGI 1500-175-480, XGI 1500-200/200-480, XGI-225-600, XGI 1500 250/250-600	30 inverters per transformer

3.2 Direct Connection to Grid Service

The Yaskawa Solectria Solar XGI 1500 three-phase transformerless inverters may be installed in parallel with AC output at a single point of connection creating a low-voltage building block. The low voltage blocks may then be connected directly to grid service without a step-up transformer if

the inverter AC voltage matches the supply voltage. The requirements for direct connection to grid service are:

1. The grid’s nominal voltage/frequency and variation range must follow U.S. grid standard/code.
2. The inverter AC voltage must match the supply voltage.
3. System voltage drop between the inverter’s AC output and the grid connection point should not significantly affect the grid voltage at the inverter. If the system AC voltage drop is too high, the inverter will disconnect from the grid due to AC over-voltage. The AC-side wiring voltage drop should be limited to minimize power loss in the wires. **Yaskawa Solectria Solar recommends that the AC voltage drop be < 2% of Vnom (nominal AC voltage) at maximum power production.** The temperature rise in cables and the ambient temperature should be considered in the voltage drop calculation.

Inverter Model	Nominal Voltage
XGI 1500-175-480, XGI 1500-200/200-480	480/277 Vac
XGI 1500-125/125-UL, XGI 1500-125/150-UL, XGI 1500-150/166-UL, XGI 1500-166/166-UL, XGI-225-600, XGI 1500 250/250-600	600/347 Vac

3.3 Connection via Transformer

The use of a transformer is acceptable if it is required to step-up/down nominal voltage and/or to comply with the above acceptable service configurations for Yaskawa Solectria Solar’s XGI 1500 three-phase transformerless inverters.

If the connection to the grid is through a transformer, then the following additional requirements apply:

1. The transformer impedance must be no greater than 6%.
2. No oversizing of the transformer is required by Yaskawa Solectria Solar. However, the transformer kVA rating must be at least the sum of the kVA ratings of all the XGI inverters connected to it.
3. Additionally, it is suggested that the transformer be selected based on IEEE C57.159-2016 *Guide on Transformers for Application in Distributed Photovoltaic (DPV) Power Generation Systems* and IEEE C57.91-2011 *Guide for Loading Mineral Oil Immersed Transformers*. It is the responsibility of the system designer to determine the reliability of the transformer and all other system parameters.

Example 1: 4.5 MWac building block with XGI 1500-225 inverters set to default kVA of 225kVA

The XGI 1500-225 inverters have a standard, continuous, apparent output power rating of 225 kVA. If twenty (20) of these inverters are paralleled onto one winding of a transformer, the minimum rating of the transformer should be calculated as follows:

Tr (minimum apparent power rating of transformer) = (# inverters) x (inverter apparent power rating)

$$\text{Tr} = 20 \times 225 \text{ kVA} = 4,500 \text{ kVA or } 4.5 \text{ MVA}$$

A transformer with a **minimum** rating of 4.5 MVA may be used with (20) XGI 1500-225 inverters in the default standard mode and connected in parallel to a secondary winding or to the low voltage side of the transformer.

Example 2: 4.5 MW building block with XGI 1500-225 inverters, apparent power overhead mode (via password protected selection)

XGI 1500-225 inverters in apparent power overhead mode have a continuous apparent output power rating of 250 kVA. If twenty (20) of these inverters are paralleled onto one winding of a transformer, the minimum rating of the transformer should be calculated by the following:

Tr (minimum apparent power rating of transformer) = (# inverters) x (inverter apparent power rating)

$$\text{Tr} = 20 \times 250 \text{ kVA} = 5,000 \text{ kVA or } 5 \text{ MVA}$$

A transformer with a **minimum** rating of 5 MVA may be used with (20) XGI 1500-225 inverters in apparent power overhead mode connected in parallel to a secondary winding or to the low-voltage side of this transformer.

4. Conclusion

System designs utilizing multiple inverters in parallel must follow the recommendations in this document. Additional requirements for installation of these inverters are found in their respective Installation and Operation Manuals (<https://www.solectria.com/support/documentation/>). It is recommended that customers contact a Yaskawa Solectria Solar Application Engineer to review projects with complex AC system designs.

Yaskawa Solectria Solar is not liable or responsible for any damages, including indirect, special, incidental or consequential damage caused by reliance on the content presented, including, but not limited to any omissions, typographical errors, arithmetic errors or listing errors.

The technical information and cross references in this document are subject to further development, and Yaskawa Solectria Solar reserves the right to make changes at any time without notification.